


The Water Opportunity Show™
Residential • Commercial • Industrial

WQA
AQUATECH
USA

Drinking Water Corrosion
Control and Remediation




Greg Reyneke CWS-VI

Learning Objectives

Symptoms of Corrosion

- Types & Causes of Corrosion
- Lead & Copper Rule
- Regulatory Environment
- Corrosion Prevention & Remediation
- POU Devices
- Challenges & Opportunities




WQA
AQUATECH
USA

WQA Aquatech USA 2013 • Indianapolis, Indiana


Symptoms of Corrosion


- Color in water
- Color on surfaces
- Tastes & Odors
- Sediment and Particulate
- Leaks in Tubing/Piping, Appliances or Fixtures



WQA
AQUATECH
USA

WQA Aquatech USA 2013 • Indianapolis, Indiana

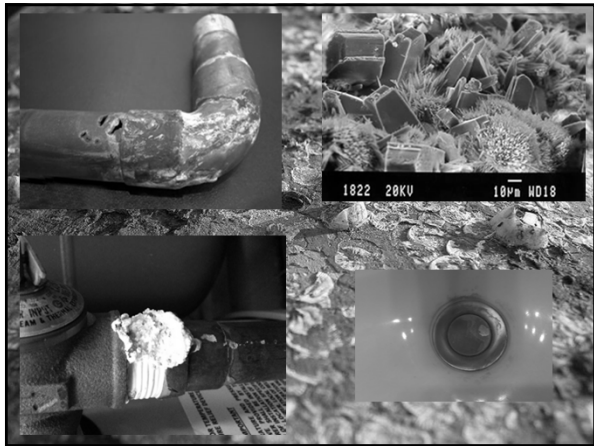

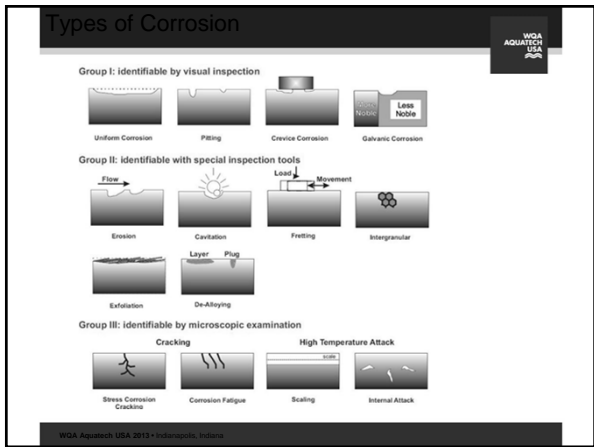

Causes of Corrosion

- High Velocity
- High Conductivity/TDS
- Low pH
- High Temperature
- Chlorine, Chloramines, and Chlorides
- DIC – Dissolved Inorganic Carbonates
- Dissimilar Metal contact – Direct or via electrolyte
- Biofilm Accumulation – Microbially Induced Corrosion

	Control	1 mg/L Al	3 mg/L Cl ₂	7 mg/L Al and 3 mg/L Cl ₂
15				
75				
200				

Electrochemical Corrosion of Iron

Oxidation = LOSS of electrons

Dissimilar Metals

Anode (Most Active)

↑

Cathode (Least Active)

Metal	Index (V)
Gold, solid and plated; Gold-platinum alloy	0.00
Rhodium plated on silver-plated copper	0.05
Silver, solid or plated; monel metal. High nickel-copper alloys	0.15
Nickel, solid or plated; titanium alloys; Monel	0.30
Copper, solid or plated; low bronzes or bronzes; silver solder; German silver high copper-nickel alloys; nickel-chromium alloys	0.35
Brass and bronzes	0.40
High bronzes and bronzes	0.45
18% chromium type corrosion-resistant steels	0.50
Chromium plated; tin plated; 12% chromium type corrosion-resistant steels	0.60
Tin-plated; tin-lead solder	0.65
Lead, solid or plated; high lead alloys	0.70
2000 series wrought aluminum	0.75
Iron, wrought, gray or malleable, plain carbon and low alloy steels	0.85
Aluminum, wrought alloys other than 2000 series aluminum, cast alloys of the silicon type	0.90
Aluminum, cast alloys other than silicon type, cadmium, plated and chromate	0.95
Hot-dip-zinc plate; galvanized steel	1.20
Zinc, wrought; zinc-base die-casting alloys; zinc plated	1.25
Magnesium & magnesium-base alloys, cast or wrought	1.75
Beryllium	1.85

Maintain < 0.15V Differential wherever possible


Biofilm formation:


Attachment Colonization Growth

BULK FLUID

SURFACE

© 1995 CENTER FOR BIOFILM ENGINEERING MSU-BOZEMAN

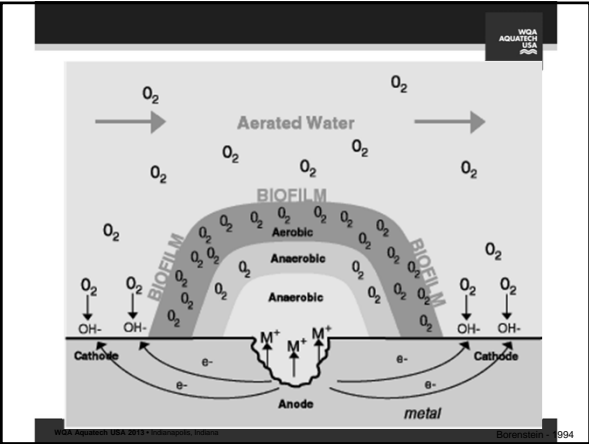

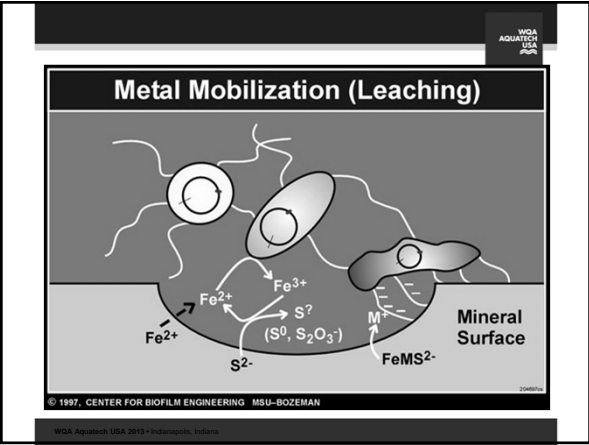

Health Effects of Corrosion Byproducts

Lead	Copper
Low birth weight	Stomach Distress
Retarded development	Intestinal Distress
Lower IQ	Liver Damage
Damaged hearing	Kidney Damage
Reduced attention span	Wilson's Disease Complications
Kidney Damage	
Reproductive damage	

Kayser-Fleischer ring - Wilson's Disease

WQA Aquatics USA 2013 • Indianapolis, Indiana

Lead & Copper Rule (LCR)

WQA
AQUATICK
USA
Pb

Lead and Copper Rule (LCR)2, 56 FR 26460 - 26564, June 7, 1991

“To protect public health by minimizing lead (Pb) and copper (Cu) levels in drinking water, primarily by reducing water corrosivity”

Action Level:
15 ppb Lead
1.3 ppm Copper

Maximum Contaminant Level Goal:
0 ppb Lead
<1.3 ppm Copper

WQA Aquatich USA 2013 • Indianapolis, Indiana

Decisions...

WQA
AQUATICK
USA
Pb

Should we
address causes
or symptoms?

WQA Aquatich USA 2013 • Indianapolis, Indiana


Regulatory Environment

WQA
AQUATICK
USA
Pb


Safe Drinking Water Act (SDWA) defines **<8% lead content** by weight as “Lead-free”

After January 4th 2014, lead free means < 0.25% by weight for wetted surfaces


Shower valves and service saddles are exempt from Public Law 111-380, California, and Louisiana laws.
Vermont and Maryland laws do not exempt service saddles.



Lead-Free



CW617N - CuZn39Pb2
Standard Brass



CW511L - 0T37 USA
Lead Free Brass

No-Lead Brass is currently 25-40 percent more expensive than leaded brass

WQA Aquatich USA 2013 • Indianapolis, Indiana

Regulatory Environment

What is NSF/ANSI 61?

NSF/ANSI 61 is a **performance-based** standard established to measure contaminants introduced into drinking water from products. The contaminants include regulated metals including lead and copper, organics and pesticides. For more information on NSF 61 see: www.nsf.org/business/water_distribution/faq.asp#general

What is NSF/ANSI 61 Annex F?

NSF/ANSI 61 Annex F requirement reduces the allowable limit for lead extracted from test bodies from 15 ppb to 5 ppb (parts per billion). The Annex F requirement has an effective date of July 1, 2012.

What are NSF 61 Annex G and NSF 372?

NSF/ANSI 61 Annex G and NSF/ANSI 372 are **lead content** standards that can be used to verify the lead content of any product, material and component that conveys or dispenses water for human consumption.

Certified to NSF/ANSI 372

WQA Aquatouch USA 2013 • Indianapolis, Indiana

POE Corrosion Prevention Strategies

- TDS –100 – 500 TDS Range
- pH range 7.0 – 10.0
- Raise total alkalinity
- Flow - Design to minimize turbulence
- Dissimilar Metals – Separation & Isolation
- External factors – Ground paths, peripheral metallic contact
- Dissolved/Entrained Gases
- Biofilm- Maintain a sanitary system, regularly disinfect POE equipment

WQA Aquatouch USA 2013 • Indianapolis, Indiana

Corrosion Remediation Strategies

- Identify Causal Factors
- Remove Causal Factors
- Identify Damaged Areas
- Replace Damaged Areas
- Chemicals & Coatings

WQA Aquatouch USA 2013 • Indianapolis, Indiana

Protecting Drinking Water

WQA
AQUATOP®
USA
PUB

- Adopt a layered approach
- Control causal factors
- Reduce contaminants in general for the entire building
- Provide a “final-barrier” of protection for all drinking water locations

City






- Aeration
- Soda Ash/Limestone
- Orthophosphate
- Silicates

POE


- pH Neutralizer
- Orthophosphate
- Salt-based Ion Exchange
- EDI/CDI
- RO/Nano

POU

- Reverse Osmosis
- Carbon Block for Lead
- Distillation
- Ion Exchange



WQA Aquatop USA 2013 • Indianapolis, Indiana



POU Treatment Technologies

WQA
AQUATOP®
USA
PUB

Lead	Copper
Ion Exchange	Ion Exchange
Reverse Osmosis	Reverse Osmosis
Distillation	Distillation
Deionization –EDI/CDI	Deionization –EDI/CDI
Carbon Block	
Poly/Orthophosphates	Poly/Orthophosphates

WQA Aquatop USA 2013 • Indianapolis, Indiana

7

Testing

The image shows a hand holding a Salifert Cu Profi Test kit, which includes a test tube and a colorimetric chart. Next to it is a DR/890 Colorimeter, a digital device used for measuring the concentration of substances in water. The screen of the colorimeter displays a reading of 0.65 mg/L. The device has buttons for PRGM, SETUP, PRINT, and EXIT.

Testing

- Multiple samples per jobsite
 - Untreated
 - Treated Cold
 - Treated Hot
- Clean sample container
- Rinse with water to be sampled
- Slow sample draw – avoid aeration

✓ Run water for at least 60 seconds at testing point for NON LCR tests

✓ Draw after sitting overnight for LCR test

If there is even a remote suspicion that human health could be at risk or if there is legal liability, take samples to a certified laboratory

Always follow manufacturer's instructions

The image shows a container of LaMotte Insta-TEST 35 Pool & Spa Test Strips. The container is white with blue and red text. It lists the parameters tested: Alkalinity, pH, Copper, and Hardness. The LaMotte logo is at the bottom.

Challenges to Implementation

- Compounding Chemistry**
 - Water that otherwise meets standards can become more corrosive after softening
- Water Softeners/Conditioners**
 - Resin fouling & subsequent metal/mineral dumping
 - Regeneration malfunctions
 - Bacterial colonization
- Media Filtration Systems**
 - Bacterial Colonization during regular service
 - Media Replacement frequency and sanitization
 - Chemical interactions
- General Legal Issues**
 - Installation methods and materials
 - Follow-up testing

Closing Thoughts...



- Cities can't realistically protect everyone, all the time
- Consumers don't trust their drinking water to be 100% safe
- Most consumers don't like the taste of city water
- Even when water meets "minimum standards", most consumers/users believe that it isn't good enough
- All drinking or process water should be filtered

WQA
AQUA1001
USA
PUB
